

# LOW NO<sub>x</sub> MAXIM • PACKAGED GAS WATER HEATER

## AquaPLEX® STORAGE TANK (UNLINED DUPLEX ALLOY)

### TANK SERIES 119 GALLON

MODEL NUMBER	20 L 119A-MXS
GPH Recovery at 70° to 140°F ①	276
GPH Recovery at 40° to 140°F ②	198
Input Btu/h	199,000
* Minimum gas inlet pressure – " W.C.	4.5
A Cold Inlet - NPT	2
B Hot Outlet - NPT	2
C Drain - NPT	1
D I - Beam Skids	3 X 34-1/2
E Overall Depth	47
F Overall Height	75
G Flue Outlet Diameter	5
H Gas Inlet - NPT	3/4
J Motor HP 120V, 1Ø, 60 Hz.	1/6
Motor Amps	3
L Height to Outlet	65
M Height to Inlet	28
Approx. Shipping Weight - lbs	980

① Recoveries derived from DOE 10 CFR 431 testing requirements (ANSI Z 21.10.3 @ 70° to 140°F)


② Recoveries based upon 40°F entering water temperature

Dimensions are in inches unless otherwise specified.

\* The information presented is for natural gas 0.6 S.G. –

For operation with propane (LP gas), consult the factory.

For standard and optional equipment, see Form # PV8123.

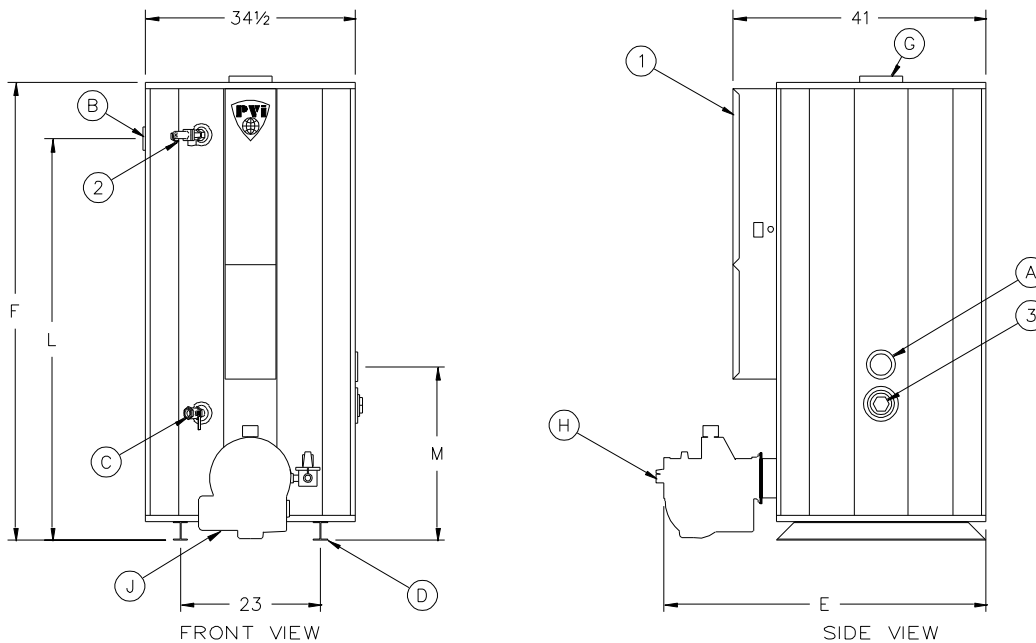

1. Control Enclosure
2. ASME Temperature & Pressure Relief Valve
3. 3" Handhole Cleanout

**STANDARD GAS PRESSURE REQUIREMENTS:**  
 SEE TABLE FOR **MINIMUM** PRESSURE BY MODEL NUMBER.  
 MAXIMUM STATIC PRESSURE: 10.5" W.C.  
 FOR GAS PRESSURES OUTSIDE OF THIS RANGE,  
 CONTACT YOUR PVI REPRESENTATIVE.

**STANDARD ELECTRICAL REQUIREMENTS:**  
**CONTROL VOLTAGE:** 120V, 1Ø, 60 HZ., 2 AMPS  
**MOTOR VOLTAGE:** 120V, 1Ø, 60 HZ  
 SEE ABOVE CHART FOR BLOWER MOTOR AMPS

**VENTING REQUIREMENTS:**  
 -.02" TO -.06" W.C. (NEGATIVE PRESSURE)  
 TYPE B VENTING.  
**THE ENTIRE VENT SYSTEM SHOULD NEVER BE SIZED BASED UPON THE  
 VENT CONNECTION DIAMETER EXCLUSIVELY.  
 FOR PROPER VENT SIZING, CONSULT THE NATIONAL FUEL GAS CODE  
 UNDER "FAN-ASSISTED".**

**PVI RESERVES THE RIGHT TO CHANGE THE DESIGN  
 AND SPECIFICATION WITHOUT NOTICE.**