

# MAXIM • PACKAGED GAS /OIL WATER HEATER

## AquaPLEX® STORAGE TANK (UNLINED DUPLEX ALLOY)

### TANK SERIES 125 GALLON

MODEL NUMBER ▶	40-2.8 L 125A-PGO	54-3.8 L 125A-PGO	72-5.0 L 125A-PGO
GPH Recovery at 40° to 120° F	500	670	900
GPH Recovery at 40° to 140° F	400	540	720
Input Btu/h	400,000	540,000	720,000
Input gph #2 Fuel Oil	2.8	3.8	5.0
A Cold Inlet - NPT	2	2	2
B Hot Outlet - NPT	2	2	2
C Drain - NPT	1	1	1
D I - Beam Skids	3 x 34-1/2	3 x 34-1/2	3 x 34-1/2
F Overall Height	75	82	82
G Flue Outlet Diameter	7	8	10
H Gas Inlet	1	1	1
Minimum Inlet Flow Gas Pressure	4.5" W.C.	4.5" W.C.	6.5" W.C.
Maximum Static Gas Pressure	14" W.C.	14" W.C.	14" W.C.
J Oil Inlet	1/2	1/2	1/2
Motor HP 120 V, 1Ø, 60 Hz.	1/3	1/3	1/2
Motor Amps	8	8	10
L Height to Outlet	65	73	73
M Height to Inlet	28	36	36
N Depth of Burner Housing	31	31	31
Max. Oil gph (gear capacity) Ⓞ	20	20	20
Approx. Shipping Weight - lbs	1120	1260	1370

Recoveries based on 83% thermal efficiency. ASHRAE 90.1 compliant.


Ⓞ Standard gear capacities may change depending on burner supplier.

Designer must use gear capacities from the above chart to size the oil distribution piping system; including transfer pumps (if used).

The information presented is for Natural gas 0.6 S.G.—For operation with Propane (LP gas), consult factory.

Dimensions are in inches unless otherwise specified.

For standard and optional equipment, see form PV 8403.

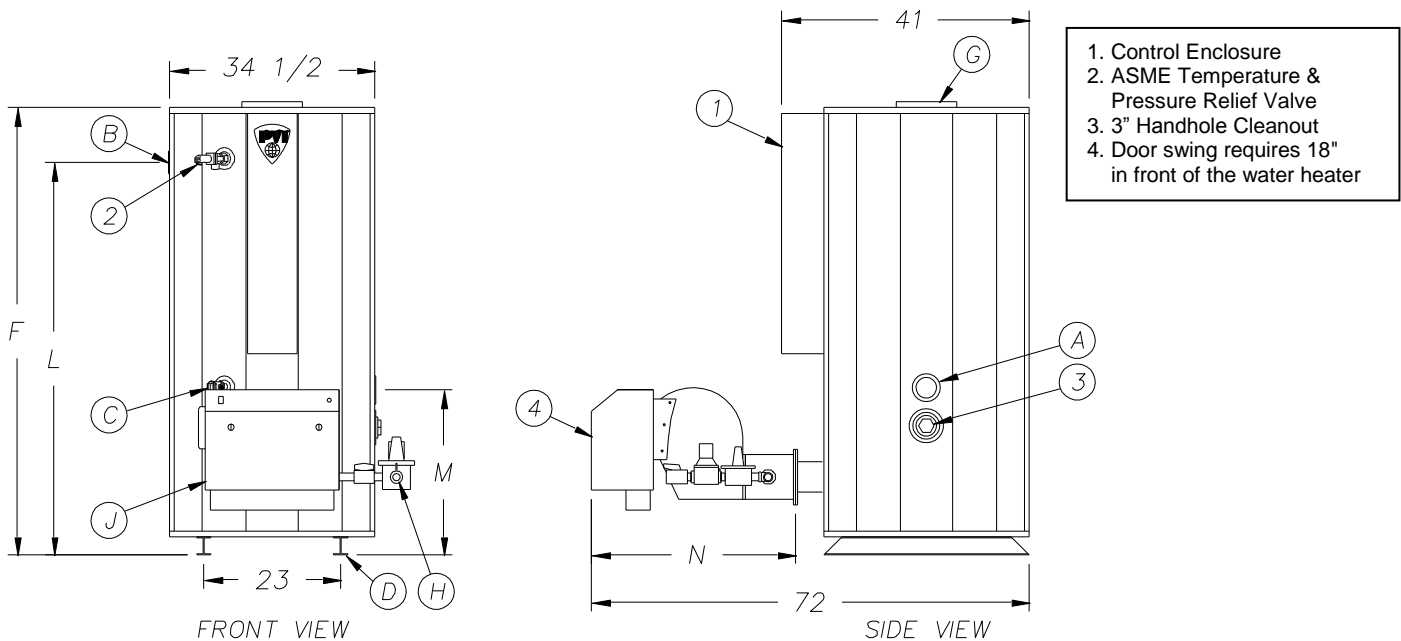

#### STANDARD ELECTRICAL REQUIREMENTS:

**CONTROL VOLTAGE:** 120V, 1Ø, 60 HZ., 2 AMPS

**MOTOR VOLTAGE:** 120V, 1Ø, 60 HZ.

SEE ABOVE CHART FOR BLOWER MOTOR AMPS

#### VENTING REQUIREMENTS:

-.02" TO -.06" W.C. (NEGATIVE PRESSURE).

**THE ENTIRE VENT SYSTEM SHOULD NEVER BE SIZED BASED UPON THE VENT CONNECTION DIAMETER EXCLUSIVELY.**

**FOR PROPER SIZING, CONSULT THE NATIONAL FUEL GAS CODE UNDER "FAN-ASSISTED".**

**PVI RESERVES THE RIGHT TO CHANGE THE DESIGN AND SPECIFICATION WITHOUT NOTICE.**