






PIPING GUIDELINE: TWO TURBOPOWER® 99 WATER HEATERS WITH SUPPLEMENTAL STORAGE TANK

	Union
	Isolation Ball Valves
	Check Valve
	T&P Relief Valve (pipe in accordance with local codes, or direct to drain with no valves or restrictions)

Tank fitting location may vary from those shown.

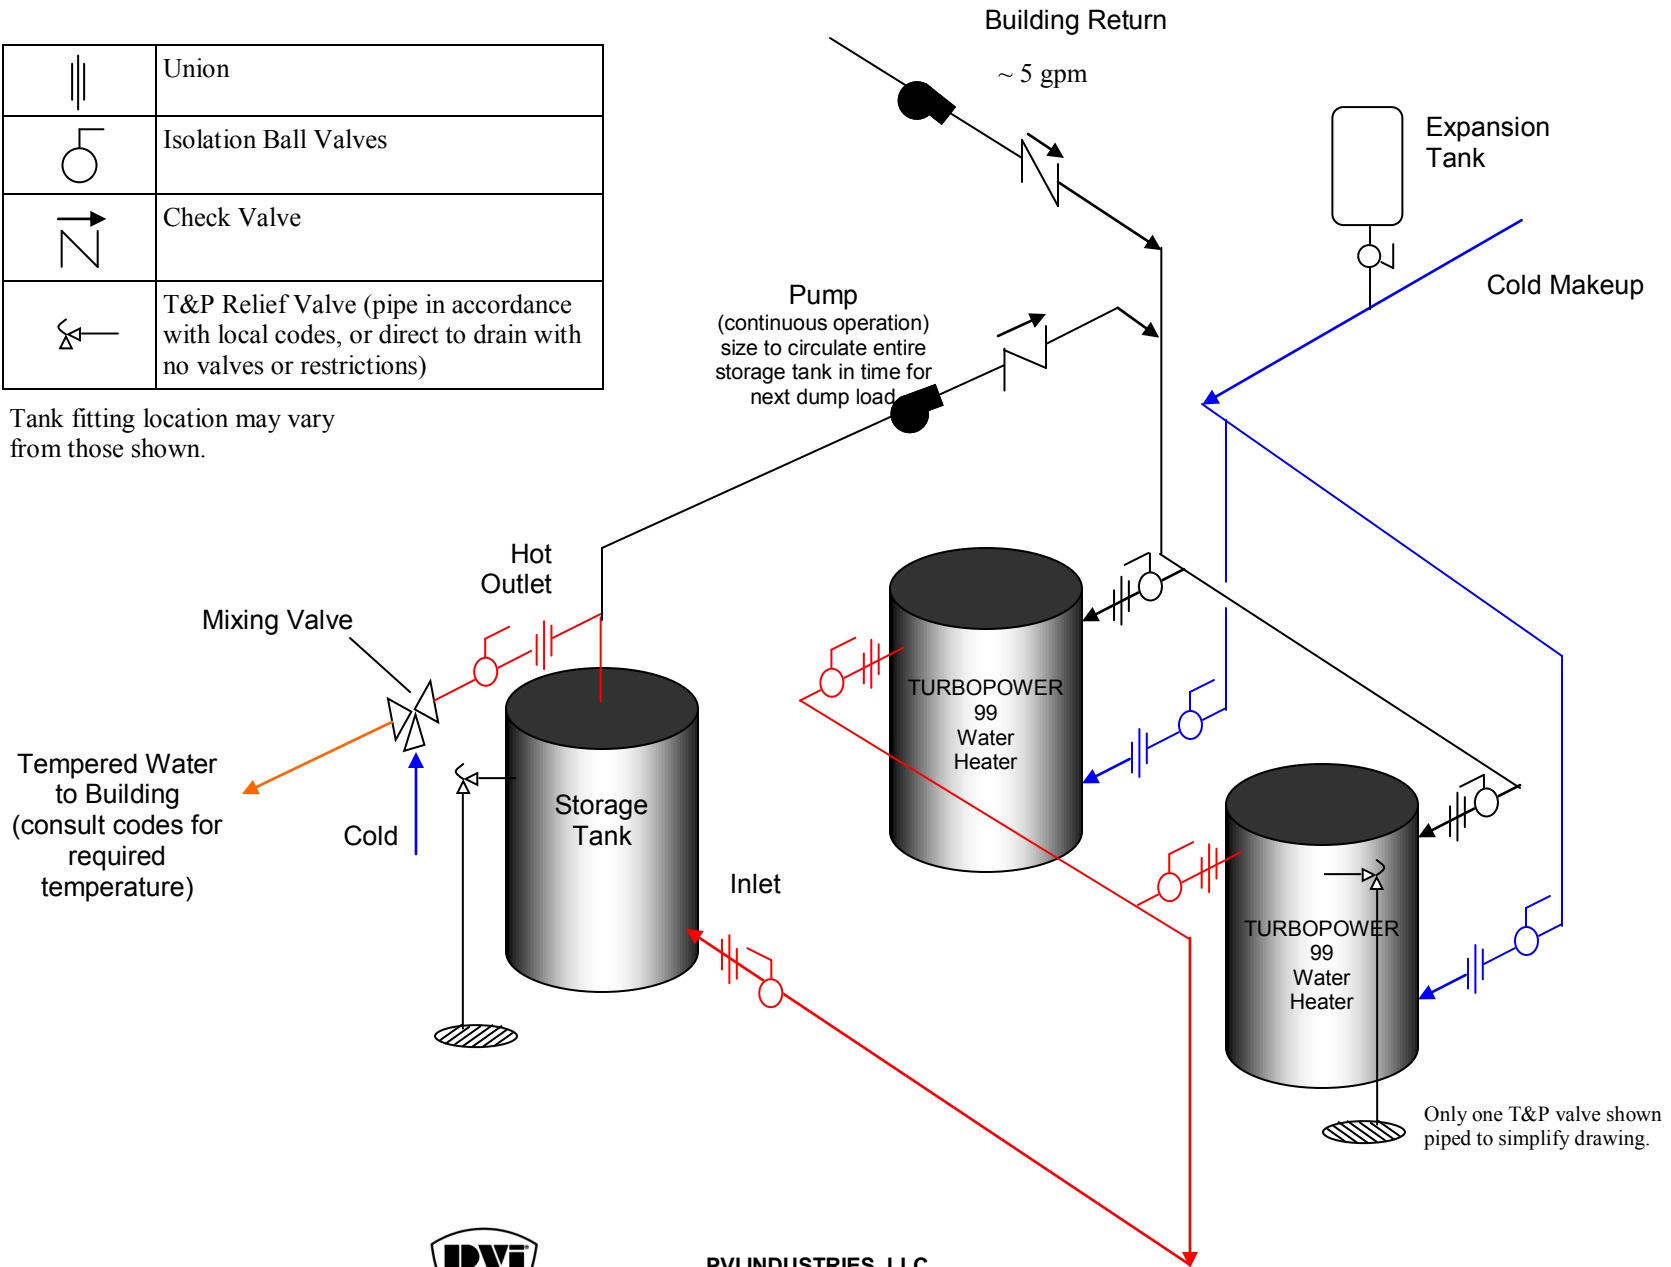

PVI INDUSTRIES, LLC
 FORT WORTH, TEXAS 76111
 (800) 784-8326 • (817) 335-9531 • www.pvi.com