


SUGGESTED PIPING DIAGRAM STEAM SIDE PIPING TO DUAL EXCHANGER COBREX UNITS (Configurations 4 and 6)

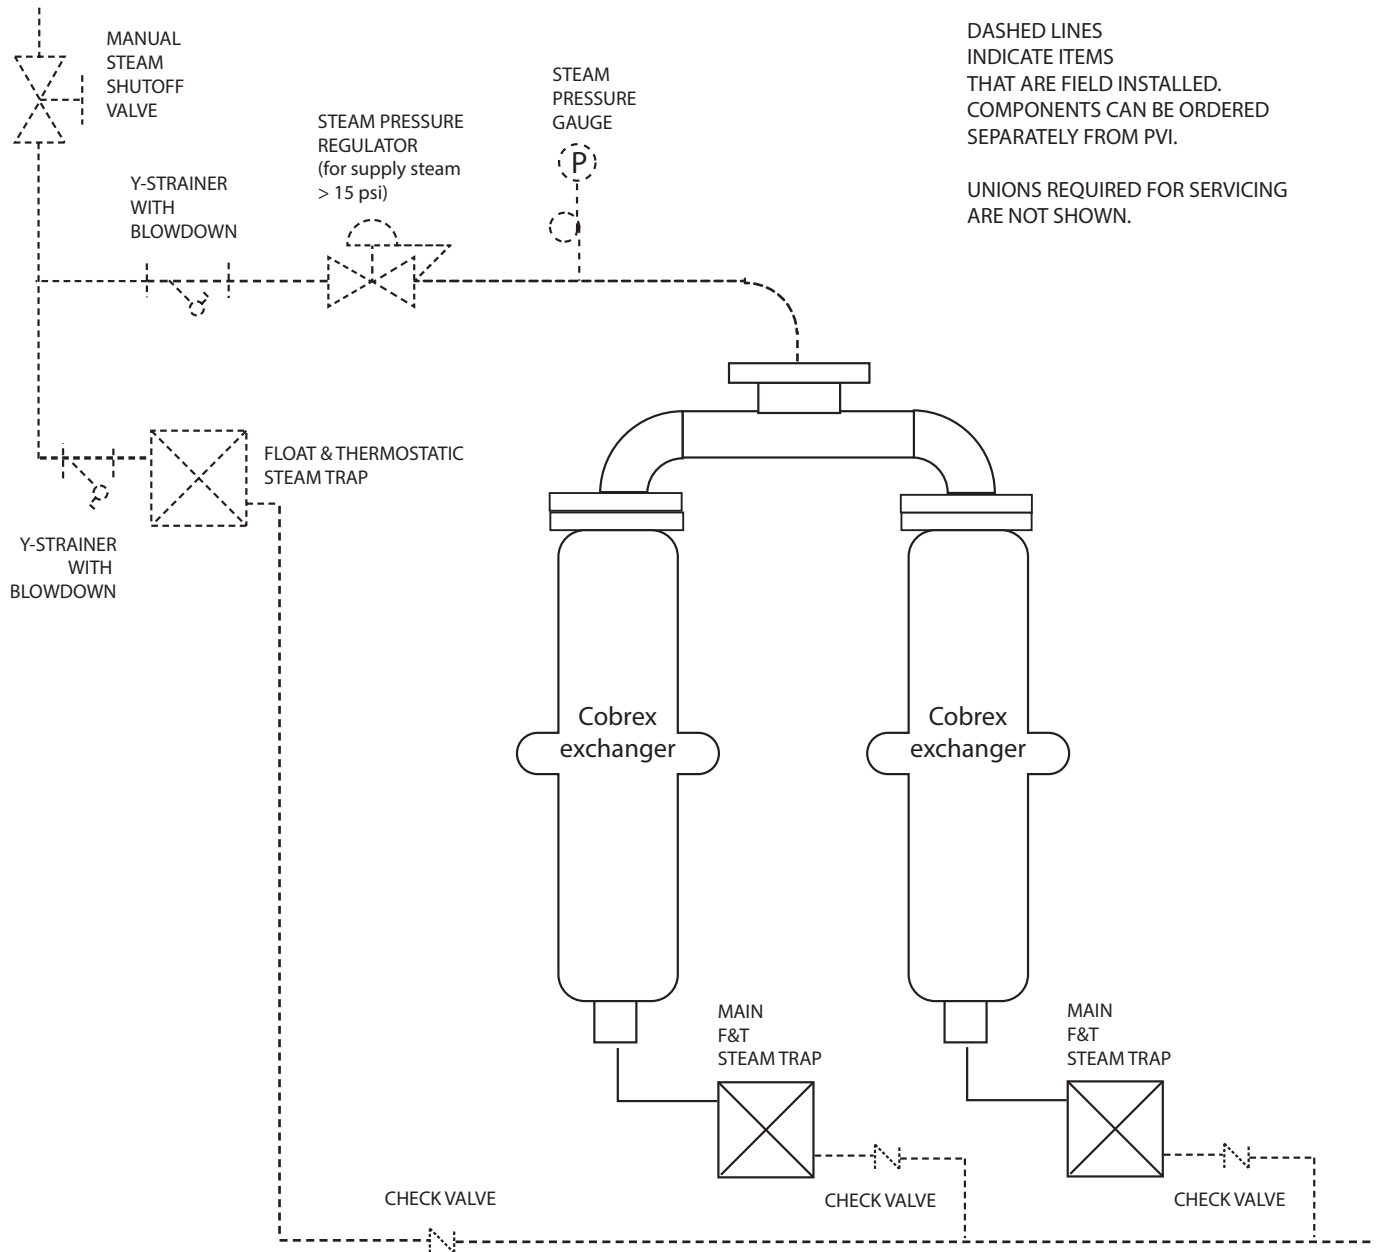

DASHED LINES INDICATE ITEMS THAT ARE FIELD INSTALLED. COMPONENTS CAN BE ORDERED SEPARATELY FROM PVI.

UNIONS REQUIRED FOR SERVICING ARE NOT SHOWN.

PIPE TO VENTED CONDENSATE RECEIVER. DO NOT ATTEMPT TO LIFT CONDENSATE.

